

*the* MALL *at*  
GREEN HILLS

**CONSTRUCTION  
CRITERIA**

10/25/23

## Table of Contents:

	<b>Page</b>
Introduction	3
Project Information	4
Structural	5
Heating, Ventilation and Air Conditioning	8
Plumbing	15
Electrical	19
Fire Alarm	22
Fire Protection	24
HVAC & BAS Systems - Schematic Diagrams	26
HVAC System Map	31

## Introduction

Information contained in this section has been assembled to assist the architect and the architect's consultants in preparation of Construction Documents and Specifications. The architect is responsible for adhering to the requirements outlined in the **Lease Criteria** as well as the following criteria.

The Mall at Green Hills will provide an opportunity for Tenant's to express their individual identity & branding through the use of high end, sophisticated and sustainable materials. We encourage the use of sustainable design and construction practices for all aspects of Tenant improvements.

The following Construction Document Criteria and the Design Criteria, which are available on our website at <http://tenantcoordination.taubman.com>, were created to help define the Design Philosophy.

***Landlord's Criteria is intended to assist with the Tenant's design with respect to the limitations of the Base Building systems; to ensure that the interfaces between the tenant systems and the Base Building systems conform to the respective limitations. Landlord's Criteria does not ensure satisfactory performance of tenant systems, nor compliance with any Code regulations and ordinances. It is the Tenant's sole responsibility to ensure that tenant systems will perform to the Tenant's satisfaction.***

## Project Information

**Landlord's Tenant Coordinator:** The role of the Tenant Coordinator is to serve as liaison between Landlord and the Tenant, Tenant's architect and Tenant's contractor. All plans and correspondence concerning Tenant's construction are to be submitted to the Landlord's Tenant coordination Department.

### **Tenant Coordination**

Green Hills

**Stephanie Bessette, Sr. Tenant Coordinator**

200 East Long Lake Road

P.O. Box 200

Bloomfield Hills, MI 48303-0200

Phone: (248) 258-6800

**Direct Dial: (248) 258-7463**

**Email:** sbessette@taubman.com

### **Mail Address**

The Mall at Green Hills

Management Office

2126 Abbott Martin Road

Nashville, TN 37215

Phone: (616) 298-5478

**Facilities Director: Kendall Lasley**

**Phone: (615) 265-9367**

### **Building Information**

Construction Type: 2B Unprotected/Fully Sprinkled

Zoning Classification: Mercantile

## Structural

**Modifications and Alterations: Modifications and alterations to Landlord's framing structure and floors will not be permitted without Landlord's prior written approval.** In the event that Landlord approves Tenant's request, Tenant shall leave Landlord's structure as strong as or stronger than original design with finishes unimpaired. Conditions vary by location. Refer to Base Building Structural drawings for more information and Field verify all structural conditions:

1. **Floors on Grade: Tenant** shall provide a 4" concrete slab with a minimum strength of 3,000 PSI on a reinforced with 6" x 6" – W1.4 x W1.4 WWF on a vapor barrier (10 mil minimum). **Tenant shall provide additional compacted sand fill and remove excess as required.**
  - a. **Structural Design Loads:** First Level: 100 psf (unreducible) - subject to Landlord review and approval.
2. **Expansion Building (Building E) - Lower Level Floors:** Landlord provided 3 1/4" thick concrete topping slab on (2) layers of 1 1/2" high compressed polystyrene (60 PSI) on **post tensioned concrete slab.** Approximate 3/4" depression occurs within concrete slab in designated areas adjacent to the Tenant's storefront lease line.
  - a. **Structural Design Loads:** Second Level: 100 psf (non-reducible).
  - b. **Post Tensioned Slabs:** LEVEL 1 - The mall level 1 built- up slab is supported on a post-tensioned concrete slab and beam floor system. Refer to the mall shell drawings for locations and extents of post-tensioned beams. The tenant shall plan their required slab penetrations for utilities so that any required cores will clear the edge of concrete beams by a minimum of 2" from edge of beam to edge of cored hold. No cores shall be permitted to extend vertically or horizontally through post-tensioned beams.
    - i. **Cores in post tensioned slabs:** Refer to **Building E Construction Criteria - Attachment G Figures:** Figure G-1 Typical Slab Core Detail at Mild-Reinforced Concrete Slab (Alt Plan Grids B.62-D.49 and J.12-K.99) and

- ii. Figure G-2 Typical Post-Tensioned Slab Core Detail\*, provided by landlord, which outlines slab coring requirements. Slab cores shall not exceed 6" in outside diameter of the cored hole. Slab reinforcing shall be located and cleared in strict accordance with the Typical Detail. Slab cores shall be spaced a minimum of 18" apart in any direction.
    - iii. Tenant shall X-Ray post-tension slab prior to making floor penetrations. Coordinate with Mall Facilities Team.
  - c. Floors: Tenant shall repair or replace any part of the existing concrete slab which may have been removed by Landlord or Tenant to allow for extension of underground and underfloor utilities. Backfill and compaction shall be provided by Tenant at utilities below grade. At level 1 floor, the tenant shall repair the existing built-up slab in strict accordance with Attachment G, Figure G-3 typical built-up slab repair detail\* provided by the landlord. See also Demolition item 3, Post-Tensioned Slabs.
- 3. **Upper Level Floors:** The upper level roof consists of steel beams and bar joists supported by concrete columns.
  - a. Landlord provided two-way concrete flat slab in the Kroger Deck area.
    - i. **Structural Design Loads:** Second Level: 75 psf (reducible).
  - b. The remainder of the Mall is composite concrete construction with steel beams and columns. Approximate 2" depression may occur within concrete slab in designated areas adjacent to the Tenant's storefront lease line.
    - i. **Structural Design Loads:** Second Level: 100 psf (reducible).
- 4. **Expansion Building (Building E) - Upper Level Floors:** Landlord provided concrete slab on composite metal deck (2 1/2" thick concrete on 3" metal deck - 5 1/2" thick total thickness). Approximate 1" depression occurs within concrete slab in designated areas adjacent to the Tenant's storefront lease line. (See B6/A-920)
  - a. Structural Design Loads: Second Level: 100 psf (non-reducible).
- 5. **For Tenants located over the old Kroger Deck area, see GFRP Structural information and diagrams.**
- 6. **Mezzanines:** Upper level floor framing has not been designed to support mezzanines. In the event an upper level Tenant is approved for a mezzanine, all structural enhancements of the floor framing and associated structure is the sole responsibility of the Tenant. Tenant shall submit structural mezzanine framing drawings and structural calculations verifying capacity

of the base building structure, prepared by a structural engineer registered in the State of Tennessee for Landlord's review and approval.

7. **Roof:** Structural design loads subject to Landlord review and approval. Tenant shall submit loading, roof framing analysis and support details - prepared by a structural engineer registered in the State of Tennessee for Landlord's review and approval.
8. **Concrete Floor Penetrations:** Required by Tenant shall be coordinated with Landlord's Field Representative structural consultant and shall be engineered to fit existing conditions and installed according to the Standard Floor Penetrations on the website
  - a. All floor penetrations in food service/preparation areas and toilet rooms shall have water tight sleeves extending a minimum of 4" above finish floor.
9. **Vibration Isolation and Sound Attenuation:** Vibration isolation requirements must be provided for all equipment (floor mounted and suspended).
  - a. Speaker systems must provide sound attenuation materials and installation methods so as not to infringe on adjacent tenants quiet enjoyment.
  - b. **Speakers must be located 20ft +/- from store entry and equipped with a separate volume control.**

#### Floor - General Requirements

1. **Transitions: All floor finishes at the storefront lease line shall be the same finish floor elevation (flush) as the Landlord's mall floor and provide recessed Schluter Type or equivalent transition strips**
  - a. All toilet rooms are to have an ADA compliant marble threshold (or equivalent) to contain water in the event of a leak.
2. **Expansion Joints:** Expansion joints in sales areas must be detailed and illustrated in the Construction Documents. Expansion joint material must be compatible with the floor finish materials.
3. **Anti-Fracture Membrane - Floor Isolation:** It is recommended to install an Anti-Fracture Membrane at the column lines, transitions between the structural slab and any shrinkage cracks that are evident.

## Mechanical Design

### 1. Landlord Provisions

- a. **Tenant Spaces that must provide their own HVAC including split systems with condensing units located on the roof.**
  - i. **Level 1 Spaces:** S170B, S171, S175A thru S175J, S177, S178, S180, S289, S424, 175, 177, 181
  - ii. **Level 2 Spaces:** 218, 256B, 278B, 272 thru 296, 2153, 415
- b. **Condenser Water Supply Central System**
  - i. Constant volume condenser water system with varying cooling tower fan speeds to maintain leaving water temperature setpoint.
  - ii. **Condenser water system is cooling only and will not be used for heating. Heating can be done with the use of electric heat.**
  - iii. Condenser water loop with valved and capped points of connection in each tenant space, tenant to verify location of tap(s) in field.
  - iv. Outside Air Ventilation:
    - i. Gravity ventilation ductwork system has been provided with a point of connection for tenant in each space, tenant to verify location of ductwork tap in field.
    - ii. **For Spaces #141 thru #169, #245 thru #265 and #2177 thru #2159 Only**
      - a. **Tenant will be required to provide a single duct VAV terminal box between the Landlord's outside air duct and the Tenant's WSHP.**
  - v. Landlord condenser water system operates 24 hours a day 7 days a week
- c. **Landlord Provided Condenser Water Characteristics**
  - i. **Condenser Water Supply Rate – 2 GPM/Ton**
  - ii. Condenser Water Supply Temperature Range
    - i. High – 103° F
    - ii. Low – 88° F
- d. **Design Conditions (Based on Governing Energy Code)**
  - i. Indoor Conditions
    - i. Summer – Minimum 75° FDB
    - ii. Winter – Maximum 70° FDB
    - iii. Lighting – Watts/SF as allowed per governing codes
    - iv. Occupancy – 1 person / 75 SF
    - v. Sensible Heat Gain – 250 BTU/HR/person
    - vi. Latent Heat Gain – 250 BTU/HR/
    - vii. Exterior Wall U Value – .043 BTU/ (HR\*F\*FT^2)
    - viii. Roof U Value – 0.32 BTU/(HR\*F\*FT^2)
  - ii. Outdoor Conditions



- i. Summer – 90° FDB / 73° FWB
- ii. Winter – 9° FDB

**e. Toilet Exhaust System**

- i. Point of connection within tenant space (tenant to verify size, location, and number of taps in field).

**2. Tenant General Requirements**

**a. Tenants designated to install Individual Heating, Ventilating and Air Conditioning Systems:**

- i. Each Tenant shall provide its own individual system as designated by specific lease requirements (i.e. heating, ventilation and air-conditioning equipment and controls, ducts, insulation, water supply, venting and drainage, fresh air supply and return, exhaust and make-up air, dehumidification and humidification equipment, water saving equipment and all structural, plumbing and electrical work related thereto). All equipment shall be designed in accordance with governing codes and adhere to the criteria below where applicable.

**b. Base Building Systems**

- i. Tenant shall not make modifications to landlord's base building systems without prior approval from landlord.
- ii. Any damage done to the landlord's base building or systems by tenant during construction shall be repaired by the landlord at the tenant's expense.

**c. Professional Engineer:** Tenant shall engage a professional engineer licensed in the state of Tennessee to prepare mechanical construction drawings and specifications.

**d. Load Calculations:**

- i. Tenant shall include space load calculations on the construction drawings.
- ii. Calculations shall conform to Tennessee Building Code – Energy Conservation, ASHRAE standards, and the landlord provided design conditions.

**e. Construction Standards:** All mechanical work shall be installed per governing codes and the landlord's tenant criteria.

**f. As-Builts:** Upon completion of tenant build out, the tenant shall provide one (1) set of pdf as-built plans for all mechanical work to the landlord.

**g. Testing and Balancing**

- i. The tenant shall use an AABC or NEBB certified HVAC balancing contractor to adjust and balance the tenant's HVAC systems.
- ii. Balance shall be done per the design air quantities indicated on the tenant's design drawings, but not in excess of airflow capacity designated by the Landlord.

- iii. **Balancing of terminal units must be completed with the landlord's required BAS contractor being present.**
  - iv. A certified balancing report must be submitted to the landlord for review and approval at least two weeks prior to opening of the leased premises or as directed by landlord.
  - v. If balancing is not performed by tenant the landlord shall balance the tenant's HVAC system at the tenant's expense.
  - h. Space Odors:** Tenants that produce odors must make provisions for maintaining acceptable negative air pressures within their space with respect to adjacent tenants and the mall concourse. **All exhaust roof equipment needs to be pointed away from outside air intakes and locations approved by the landlord.**
  - i. Existing Work:** Existing systems from previous tenant cannot be abandoned in place and must be demolished entirely if not being re-used.
  - j. Roof Openings:** Cutting and patching of roof openings shall be performed by the landlord's contractor at tenant's expense.
  - k. Labeling:** Equipment shall be labeled as required by landlord tenant construction rules and regulations manual.
  - l. Mechanical Load Calculation Check Sheets**
    - i. Shall be certified by engineer of record
    - ii. Submit with construction documents for landlord review process
- 3. Tenant Equipment and Control Requirements**
- a. Equipment Access:** Proper access shall be provided and maintained for landlord and tenant installed equipment/accessories.
  - b. Water Source Cooling Units**
    - i. Indoor self-contained water source cooling only unit(s) provided with the following:
      - i. Resistance heating if needed
      - ii. Thermostat and unit controller for standalone operation
      - iii. Auxiliary condensate drain pan
      - iv. BACNet Interface
  - c. OA VAV Terminal Units Only (Spaces #141 thru #169, #245 thru #265 and #2177 thru #2159 Only)**
    - i. Tenants shall provide a minimum of one (1) VAV terminal unit as follows:
      - i. Single Duct terminal unit(s)
      - ii. Compatible with direct digital controls
  - d. VAV Terminal Unit Controls**
    - i. Tenant shall use landlord required BAS contractor to furnish and install VAV box controller(s), thermostat(s), zone sensor(s), and all associated control wiring at tenant's expense.
    - ii. All control wiring shall be installed in conduit.

- iii. Prior to the start of demolition, the tenant shall have the landlord required contractor safe off existing VAV controls that will not be re-used at tenant's expense if applicable.

**e. Roof Mounted Equipment**

- i. Tenant rooftop equipment shall be located in areas designated by landlord at specified heights and shall submit a roof plan showing all existing and new equipment within the vicinity of the tenant space.
  - i. Should the weight or location of tenant rooftop equipment require additional supports, screens, catwalks, roof hatches, etc. they shall be provided by the tenant according to the landlord's specifications.
- ii. Tenant shall submit a roof loading analysis and support details prepared by a structural engineer registered in Tennessee. All equipment shall be mounted on rails or roof curbs and anchored to the supporting structure to withstand wind and seismic effects per governing codes. Anchorage requirements shall be provided on mechanical plans.
- iii. Roof equipment placement shall be done by crane or helicopter, equipment shall not be rolled across or improperly rested upon the roof. An equipment pick plan shall be submitted to the landlord for approval before commencement of rooftop equipment placement work.
- iv. All rooftop equipment shall be painted according to landlord's specifications.

**f. Restroom Exhaust Fans**

- i. Inline or ceiling mounted.
- ii. Connect to landlord provided toilet exhaust duct main.

**g. Auxiliary Heat**

- i. All tenant supplemental heating equipment shall be approved by landlord.
- ii. Reheat of conditioned supply air is not permitted per governing codes.
- iii. Electrical resistance heating shall be powered from tenant's panel.

**h. Fire Dampers**

- i. Shall be UL listed.
- ii. Provide at locations where ductwork penetrates a fire rated assembly.

**4. Tenant Material and Installation Requirements**

**a. Tenant Interface Drawings:** Refer to Schematic Diagrams of HVAC & BAS Systems Diagrams for more information on tenant fit out guidelines and connections to landlord systems.

**b. Hangers and Supports**

- i. Shall be supported from structural members only (not secured to the deck above).

- ii. Additional intermediate structural supports for hangers shall be installed as needed upon landlord approval.
- iii. All duct hangers exposed to public view shall be wire or rod type, shall be evenly spaced, and shall be grouped as much as possible with other trades for uniformity.

**c. Main and Branch Ductwork**

- i. Shall be fabricated of minimum 26 gauge galvanized steel, flexible ductwork is permitted for final connection to air devices (maximum length as specified per governing code).
- ii. Main duct branch connections shall be via 45 degree entry, bellmouth, or conical type and shall be provided with a locking quadrant type volume damper.
- iii. Square and rectangular duct elbows shall have double thickness turning vanes.
- iv. Supply and outside air ductwork shall be insulated as required by governing codes.

**d. SMACNA Ductwork Construction Standards**

- i. Duct Class – 2 in. water gauge
- ii. Seal Class – A
- iii. Rectangular Metal Leakage Class – 6
- iv. Round Metal Leakage Class – 3

**5. Tenant Food Service Requirements**

**a. Kitchen Hoods**

- i. Type I hoods shall be installed where cooking appliances produce grease or smoke as a result of the cooking process.
  - i. Shall include UV light system for grease mitigation in ductwork.
  - ii. Shall be provided with an approved automatic fire suppression system complying with governing codes.
    - a. Before the fire suppression system is fabricated, the system's supplier shall obtain a permit from the Nashville Fire Department, all submittals must go through Landlords permit expeditor.
- ii. Type II hoods shall be installed above dishwashers and appliances that produce heat or moisture and do not produce grease or smoke as a result of the cooking process.
- iii. Kitchen hoods shall be constructed and installed as required by governing codes.

**b. Grease Ductwork**

- i. Grease ductwork shall be constructed, installed, and tested as required by governing codes.

- ii. Grease ductwork shall be encompassed by an approved rated enclosure where required by governing codes.
  - iii. Routing of grease ductwork and placement of access doors beyond the tenant's space shall be approved by landlord.
- c. Kitchen Exhaust Fans**
- i. Shall be up-blast discharge type bearing evidence of UL & NSF approval for kitchen exhaust service.
  - ii. Locate a minimum of 30 feet horizontally away from outside air intakes or openings to the building. Exhaust must be pointed away from outside air intakes and locations confirmed with the landlord.
  - iii. Grease drain and trap.
  - iv. Cleanout port.
  - v. G2 grease guard rooftop defense system
  - vi. Minimum 40" discharge above the roof.
- d. Pollution Control Units (PCU)**
- i. A PCU shall be provided as required by governing codes.
  - ii. Landlord reserves the right to require tenant to provide a pollution control unit if kitchen exhaust fans do not meet the minimum landlord required distance from outside air intakes or openings into building.
  - iii. PCUs shall be factory assembled and capable of significantly reducing smoke, grease, and odor from the exhaust air stream
  - iv. PCUs shall be provided with an approved fire-extinguishing system and an internal detection system capable of activating fire-extinguishing system protecting the unit.
- e. Make-Up Air Units**
- i. Make-up air units shall be installed a minimum of 36" above the roof surface.
  - ii. Make-up air units shall be interlocked to start with the associated exhaust air system
- f. General Maintenance**
- i. Food service tenants shall clean their filters, hoods, duct systems, and grease collecting devices on a regular basis as determined by landlord.
  - ii. Tenants shall take the appropriate steps necessary to prevent the depositing and accumulation of grease on the roof, damage to the roof resulting from tenant neglect shall be repaired by the landlord at tenant's expense.
  - iii. The Landlord reserves the right to maintain the tenant's hoods, duct systems, and grease collecting devices at Tenant's expense.
- g. Kitchen Systems**
- i. Shall be designed and constructed such that the space is maintained at a negative pressure relative to the mall common area.

- ii. Tenant make-up air systems shall replace the minimum amount of exhaust air as required by governing codes.
- h. **Duct Lining:** Food service tenants shall not use internally lined ductwork.

## Plumbing Design

### 1. Landlord Provisions

- a. **Domestic Water:** Point of connection within leased premises, tenant to verify size and location in field.
- b. **Sanitary Waste:** Point of connection below leased premises, tenant to verify size and location in field. Confirm POC is connected to main line.
- c. **Sanitary Vent:** Point of connection within leased premises, tenant to verify size and location in field.
- d. **Grease Waste:** Point of connection may be existing for food and beverage service tenants, tenant to verify existence and location in field. Confirm POC is connected to main line.
- e. **Gas Manifold:** Provided by utility company located in exterior service courts, tenant to verify location and capacity in field. Gas piping to leased premises may be existing from previous tenant and can be reused if deemed to be in acceptable condition upon inspection and test.

### 2. Tenant General Requirements

- a. **Base Building Systems**
  - i. Tenant shall not make modifications to landlord's base building systems without prior approval from landlord.
  - ii. Any damage done to the landlord's base building or systems by tenant during construction shall be repaired by the landlord at the tenant's expense.
- b. **Professional Engineer:** Tenant shall engage a professional engineer licensed in the state of Tennessee to prepare plumbing construction drawings and specifications.
- c. **Construction Standards:** All plumbing work shall be installed per governing codes and the landlord's tenant criteria.
- d. **As-Builts:** Upon completion of tenant build out, the tenant shall provide one (1) set of pdf as-built plans for all plumbing work to the landlord.
- e. **Plumbing Calculations:** Plumbing tabulations shall be provided on drawings to include water supply fixture units (WSFU), drainage fixture units (DFU), and grease interceptor sizing calculations (if applicable).
- f. **Tenant Criteria Sections:** Refer to Architectural and Structural sections of tenant criteria for information on floor and wall construction requirements.
- g. **Existing Work:** Existing systems from previous tenant cannot be abandoned in place and must be demolished entirely if not being re-used.
- h. **Roof Openings:** Cutting and patching of roof openings shall be performed by the landlord's contractor at tenant's expense.
- i. **Labeling:** Equipment and piping shall be labeled as required by landlord tenant construction rules and regulations manual.

- j. **Plumbing Facilities:** Please see the Architectural Design Criteria and current governing codes for any requirements.

### **3. Tenant Equipment and Fixture Requirements**

- a. **Equipment Access:** Proper access shall be provided and maintained for landlord and tenant installed equipment/accessories.
- b. **Water Meter**
  - i. Refer to Landlord Team for any requirements.
  - ii. Restaurant Tenants are required to have a water meter – obtain required meter model from Landlord.
- c. **Water Heaters**
  - i. Tenants shall provide instantaneous or storage type water heater(s) as required.
  - ii. Storage type water heaters shall be floor mounted and provided with the following:
    - i. Vacuum relief valve
    - ii. Temperature and pressure relief valve with discharge piping to an indirect waste receptor
    - iii. 3/4" drain valve with male garden hose threads
    - iv. Heat trap nipples
    - v. Expansion tank
    - vi. Minimum 24 gage galvanized steel drain pan with discharge piping to an indirect waste receptor
- d. **Plumbing fixtures**
  - i. Shall be commercial grade.
  - ii. Shall Comply with ADA guidelines.
  - iii. Shall not exceed code specified maximum flow rates.
  - iv. A minimum of one (1) mop sink shall be provided within tenant space.
    - i. Mop sink for kiosks shall be concealed from public view and requirements shall be verified with local municipality.
  - v. Restrooms, janitor closets, etc. shall include at least one (1) floor drain, minimum size 3" (all floor drains shall be provided with trap primers).
- e. **Hair interceptors**
  - i. Shall be installed on all sinks, basins, special sanitary units, etc. which in any way receive human or animal hair.
  - ii. All hair interceptors must be made accessible and maintained.

### **4. Tenant Material and Installation Requirements**

- a. **Tenant Interface Drawings:** Refer to Schematic Diagrams of HVAC & BAS Systems Diagrams for more information on tenant fit out guidelines and connections to landlord systems.
- b. **Hangers and Supports**



- i. Shall be supported from structural members only (not secured to the deck above).
  - ii. Additional intermediate structural supports for hangers shall be installed as needed upon landlord approval.
  - iii. Cast iron pipe must be supported at least every five feet and at every joint/fitting.
  - iv. All hangers exposed to public view shall be evenly spaced and grouped as much as possible with other trades for uniformity.
- c. Domestic Water Piping**
- i. Above Grade: Type L drawn-temper copper tubing conforming to ASTM B88 with solder-joint fittings.
  - ii. Below Grade: Type K drawn-temper copper tubing conforming to ASTM B88 with solder-joint fittings.
  - iii. All valves for domestic water shall have a minimum CWP rating of 125 psi.
- d. Sanitary Waste and Vent Piping**
- i. Above Grade: Service weight hubless cast-iron pipe conforming to ASTM A 888 with stainless steel shield and clamps no-hub coupling.
  - ii. Below Grade: Solid-wall schedule 40 PVC conforming to ASTM D 2665 with PVC socket fittings.
- e. Gas Piping**
- i. Black steel schedule 40 pipe conforming to ASTM A 53 with steel press-connect fittings conforming to CSA LC-4 or as may be required by governing codes and landlord's insurance provider.
  - ii. All valves for natural gas piping shall be bronze plug valves with a minimum pressure rating of 125 psi.
  - iii. Tenants requiring natural gas shall arrange for gas service directly with gas utility.
  - iv. Tenant shall install all gas piping to and within their space.
  - v. All exterior gas piping shall be painted per landlord's specification.
  - vi. Gas piping on roof shall be installed on landlord specified roller supports.
  - vii. Gas piping shall be labeled per governing codes along with the tenant's name and space number.
- f. Condensate Piping:** Shall be routed to an indirect waste receptacle as required by governing code.
- g. Pipe Sleeves:** Shall be installed for penetrations through floor slabs.
- h. Escutcheons:** Shall be provided at pipe penetrations through walls and partitions within finished areas.
- i. Insulation:** All hot water and condensate piping shall be insulated as required by governing codes and be rated for use in a return air plenum.

- j. **Drain Pans:** Tenants located above any base building or Tenant mechanical/electrical rooms shall install drain pans below all piping installed by tenant (running through the rooms), properly drain and comply with all local and state codes.

## 5. Tenant Food Service Requirements

### a. Grease Waste

- i. Tenant shall provide a grease waste disposal system in accordance with governing codes.
- ii. Certain tenant spaces as designated by landlord have been provided with a grease waste system point of connection routed to an external grease interceptor.
- iii. A floor mounted grease interceptor shall be provided for each three (3) compartment sink.
- iv. Tenant furnished grease interceptors shall be in accordance with governing codes.
  - i. Provide grease waste sampling port as required by governing code.

### b. Floor Drains

- i. Kitchens, walk in coolers, and other wet areas shall include at least one (1) floor drain, minimum size 3" (all floor drains shall be provided with trap primers).

### c. Condensate Piping

- i. Rooftop air conditioning unit condensate line routing shall be coordinated with landlord.

## Electrical Design

### 1. Landlord Provisions

#### a. Electrical Service

- i. 277/480 Volt, 3 Phase, 4 Wire, 60 Hertz

#### b. Metering Switchboard

- i. In-line meter compartment
  - i. Tenant shall coordinate with utility company for installation of meter or use of existing meter

#### c. Telecommunications

- i. Telecommunications service backbone from minimum point of entry (MPOE) to intermediate distribution frames (IDF) throughout the center.
- ii. Point of connection to IDF located within tenant space for connection by tenant, tenant to verify location in field.

### 2. Tenant General Requirements

#### a. Base Building Systems

- i. Tenant shall not make modifications to landlord's base building systems without prior approval from landlord.
- ii. Any damage done to the landlord's base building or systems by tenant during construction shall be repaired by the landlord at the tenant's expense.

**b. Professional Engineer:** Tenant shall engage a professional engineer licensed in the state of Tennessee to prepare electrical construction drawings and specifications.

**c. Constructions Standards:** All electrical work shall be installed per governing codes and the landlord's tenant criteria.

**d. As-Builts:** Upon completion of tenant build out, the tenant shall provide one (1) set of pdf as-built plans for all electrical work to the landlord.

**e. Existing Work:** Existing systems from previous tenant cannot be abandoned in place and must be demolished entirely if not being re-used.

**f. Roof Openings:** Cutting and patching of roof openings shall be performed by the landlord's contractor at tenant's expense.

**g. Compliance Forms:** Tenant shall complete energy compliance forms as required per governing codes.

#### h. Electrical Data Tabulation Sheets

- i. Shall be certified by engineer of record
- ii. Submit with construction documents for landlord review process

**i. Labeling:** Equipment shall be labeled as required by landlord tenant construction rules and regulations manual.

### **3. Tenant Equipment and Fixture Requirements**

- a. Required Access:** Proper access shall be provided and maintained for landlord and tenant installed equipment, junction boxes, and accessories.
- b. Electrical Meter**
  - i. Tenant shall coordinate with utility company for installation of meter.
- c. Circuit Breakers**
  - i. Tenant shall use landlord required contractor to furnish and install circuit breaker as required for electrical service in landlord provided metering switchboard.
- d. Panelboards**
  - i. Provide panelboard(s) designed for 20% minimum spare ampacity (based on connected load) and 20% spare breaker space.
  - ii. Loads shall be balanced across all phases.
  - iii. Electrical Panels for kiosks shall be concealed from public view and requirements shall be verified with local municipality.
  - iv. Ensure sufficient space in front of electrical equipment is provided to meet electrical code requirements. Consider marking the floor areas in front of electrical equipment to ensure items are not placed or stored in these areas.
- e. Transformers**
  - i. Provide three phase dry type transformer
  - ii. Transformers shall be mounted on the floor or structural wall, not from the building structure or demising walls.
- f. Lighting Fixtures (Refer to Architectural Design Section)**
- g. Exit/Emergency Lighting System**
  - i. Tenant shall provide exit and emergency lighting system as required by governing codes.
  - ii. Emergency lighting shall be battery-operated with recessed or twin-head configuration.
  - iii. In areas visible to customers, battery assembly for exit and emergency lights shall be concealed and remote type light fixtures used.
  - iv. Exit signs must be green on edge lit or white background per governing codes.
- h. Signage**
  - i. Circuits serving sign(s) shall be connected by a time switch.
- i. Telecommunications**
  - i. Tenant shall coordinate with landlord's telecommunications service provider (Granite) for account set up and scheduling service activation.
  - ii. Telecommunications service cabling from the nearest Telecommunications Closet to the tenant's leased premises shall be the responsibility of the Tenant in conjunction with Granite.

- j. Television and Security Systems**
  - i. The installation of any roof mounted antennas or equipment must be approved by landlord and installed by landlord required contractor.
  - ii. All equipment shall be mounted on rails and anchored to the supporting structure to withstand wind and seismic effects per governing codes.
- k. Service Call System**
  - i. Tenant shall provide and install a buzzer call system located at the back service corridor.
  - ii. Buzzer call system shall not be audible in sales floor area.
- 4. Tenant Material and Installation Requirements**
  - a. Tenant Interface Drawings: Refer to Schematic Diagrams of HVAC & BAS Systems Diagrams for more information on tenant fit out guidelines and connections to landlord systems.**
  - b. Hangers and Supports**
    - i. Shall be supported from structural members only (not secured to the deck above).
    - ii. Additional intermediate structural supports for hangers shall be installed as needed upon landlord approval.
    - iii. All hangers exposed to public view shall be evenly spaced and grouped as much as possible with other trades for uniformity.
  - c. Electrical Wiring**
    - i. All conductors shall be insulated soft-drawn annealed copper type THHN/THWN building wire and color coded (aluminum conductors are not allowed).
    - ii. Tenant shall provide electrical service feeders in conduit from landlord's metering switchboard to tenant's premises.
      - i. Electrical feeders shall be sized for no more than a three percent (3%) voltage drop.
  - d. Conduit**
    - i. All electrical wiring systems shall be in conduit (metal-clad cable is not permitted).
    - ii. All exterior electrical wiring shall be in rigid metal conduit (RMC).
    - iii. Speaker, security, or other low voltage wiring within the tenant's leased premises shall be installed in conduit.
  - e. Neutral Conductor**
    - i. The neutral conductor shall not be bonded to ground at the tenant's electrical distribution equipment. The ground fault protection in the landlord's distribution system will not function properly if the neutral is bonded to ground anywhere.

## Fire Alarm Design

### 1. Landlord Provisions

- a. **Fire Alarm Panel:** Located in base building Fire Command Center.
- b. **Tenant Interface Junction Box (TIB)**
  - a. Signaling and notification circuits from base building fire alarm panel routed to terminal strip within TIB for future connection by tenant.
  - b. Tenant to verify location of TIB in field.

### 2. Tenant General Requirements

- a. **Base Building Systems**
  - i. Tenant shall not make modifications to landlord's base building systems without prior approval from landlord.
  - ii. Any damage done to the landlord's base building or systems by tenant during construction shall be repaired by the landlord at the tenant's expense.
- b. **Required Contractor:** Tenant shall engage landlord required contractor to prepare fire alarm construction drawings/specifications and install the fire alarm system within the tenant's space.
- c. **Construction Standards:** All fire alarm work shall be installed per governing codes and the landlord's tenant criteria.
- d. **As-Builts:** Upon completion of tenant build out, the tenant shall provide one (1) set of pdf as-built plans for all fire alarm work to the landlord.
- e. **Existing Work**
  - i. Existing systems from previous tenant cannot be abandoned in place and must be demolished entirely if not being re-used.
  - ii. Tenant shall use landlord required contractor to safe-off fire alarm system before any demolition work occurs.
- f. **Labeling:** Equipment shall be labeled as required by landlord tenant construction rules and regulations manual.

### 3. Tenant Equipment and Control Requirements

- a. **Code Compliance:** Tenant is required to provide a code compliant fire alarm system within their leased premises as required by governing codes and in accordance with NFPA 72, tenant shall use landlord required contractor for design and install of fire alarm system within the leased premises.
- b. **Fire Alarm System Devices:** Tenant will provide and install all initiating devices, notification appliances, addressable modules, auxiliary power supplies, junction boxes, etc. as required by governing codes and landlord specifications.
- c. **Junction Box:** Tenant is required to connect fire alarm system serving the leased premises to the landlord provided tenant interface junction box (TIB).

**d. HVAC Systems**

- i. Tenants providing independent packaged rooftop HVAC systems shall provide unit or duct mounted smoke detectors per landlord tenant construction rules and regulations manual, addressable through the center's fire alarm system.
- ii. All tenant provided supplemental ducted HVAC equipment shall interface with the center's fire alarm system for appropriate sequencing during a fire alarm emergency.

- e. Final Acceptance: Testing of the tenant fire alarm system shall be performed by the landlord required contractor concurrent with the base building fire alarm system at the tenant's expense.**

## Fire Protection Design

### 1. Landlord Provisions

#### a. **Tenant Fire Service Main (TFSM)**

- i. Ordinary hazard pipe scheduled fire protection sprinkler system main routed to tenant space with a point of connection for tenant use.
  - i. Tenant is only allowed one (1) point of connection of fire protection sprinkler system main.
  - ii. Tenant to verify location in field.
- ii. Fire protection sprinkler system is provided with a supervised alarm system, the system is monitored by the local fire department, center security, and various alarm companies.

### 2. Tenant General Requirements

#### a. **Base Building Systems**

- i. Tenant shall not make modifications to landlord's base building systems without prior approval from landlord.
- ii. Any damage done to the landlord's base building or systems by tenant during construction shall be repaired by the landlord at the tenant's expense.

#### b. **Required Contractor**

- i. Tenant shall use landlord required contractor to prepare fire sprinkler shop drawings and perform scope of work.
- ii. Fire sprinkler drawings and calculations must be submitted to landlord's insurance provider for approval before commencement of work.

c. **Construction Standards:** All fire protection work shall be installed per governing codes, the landlord's tenant criteria, and the landlord's insurance provider.

d. **As-Builts:** Upon completion of tenant build out, the tenant shall provide one (1) set of pdf as-built plans for all fire protection work to the landlord.

#### e. **Existing Work**

- i. Existing systems from previous tenant cannot be abandoned in place and must be demolished entirely if not being re-used.
- ii. Tenant shall use landlord required contractor to safe-off fire sprinkler system before any demolition work occurs.

f. **Service Interruptions:** All fire protection work must be accomplished without interrupting fire protection service to the remainder of the center during operating hours.


g. **Tenant Responsibility:** Tenant shall be solely responsible for the fire protection system within the leased premises.


h. **High Piled Storage:** Where storage/merchandise is high piled or hazard commodities are stored, coordinate design criteria with NFPA and landlord insurance provider.



### 3. Tenant Material and Installation Requirements

- a. **System Components:** All fire protection sprinkler system components shall be UL listed and landlord insurance provider approved.
- b. **Pipe Material**
  - i. Minimum schedule 40 steel pipe conforming to ASTM A53 is required.
- c. **Sprinkler Heads**
  - i. Sprinkler heads at the storefront, in show windows, and in all hard-surface ceilings must be fully concealed type.
  - ii. Semi-recessed (or concealed) type heads may be used in lay-in or other approved type ceiling systems (where accessible to the public).
  - iii. Fully pendant type sprinkler heads are permitted only in stock/storage or open ceiling areas.
  - iv. No stock or merchandise shall be within 18" of sprinkler heads.
  - v. All walk-in coolers/freezers shall be provided with a minimum of one dry sprinkler head as required by governing codes and/or landlord insurance provider.
  - vi. Ductwork greater than 4 ft. or a combination of requires sprinkler protection to be extended below the ductwork as required by governing codes and/or landlord insurance provider.
- d. **Valves**
  - i. Individual tenant control valves are not allowed in the sprinkler system.
  - ii. Permanent system isolation valves are not permitted in the system.
  - iii. Valve operation and alarm system are accomplished at source by landlord.
- e. **Mobile Storage Shelving:**
  - i. ***The solid shelving on mobile storage systems should be wire mesh shelves to allow for adequate flue spaces on the mobile (compact) storage systems. Manufacturers typically offer two options for "wire grid" shelf decking, one with 2 in. by 4 in. openings and the other with 1 in. by 4 in. openings. A less desirable alternative would be to install minimum 3 in. bumper extenders every 4 ft. to 5 ft. throughout the mobile storage system.***

 <b>E &amp; S</b> CONSTRUCTION ENGINEERS, INC. 4326 MOUNTAIN ROAD PASADENA, MARYLAND 21122 (410) 360-2280	PROJECT			The Mall of Green Hills		
	PROJECT NUMBER	2020022	DATE	10-20-2021		
	BY	RV	PAGE NUMBER	1 OF 5		

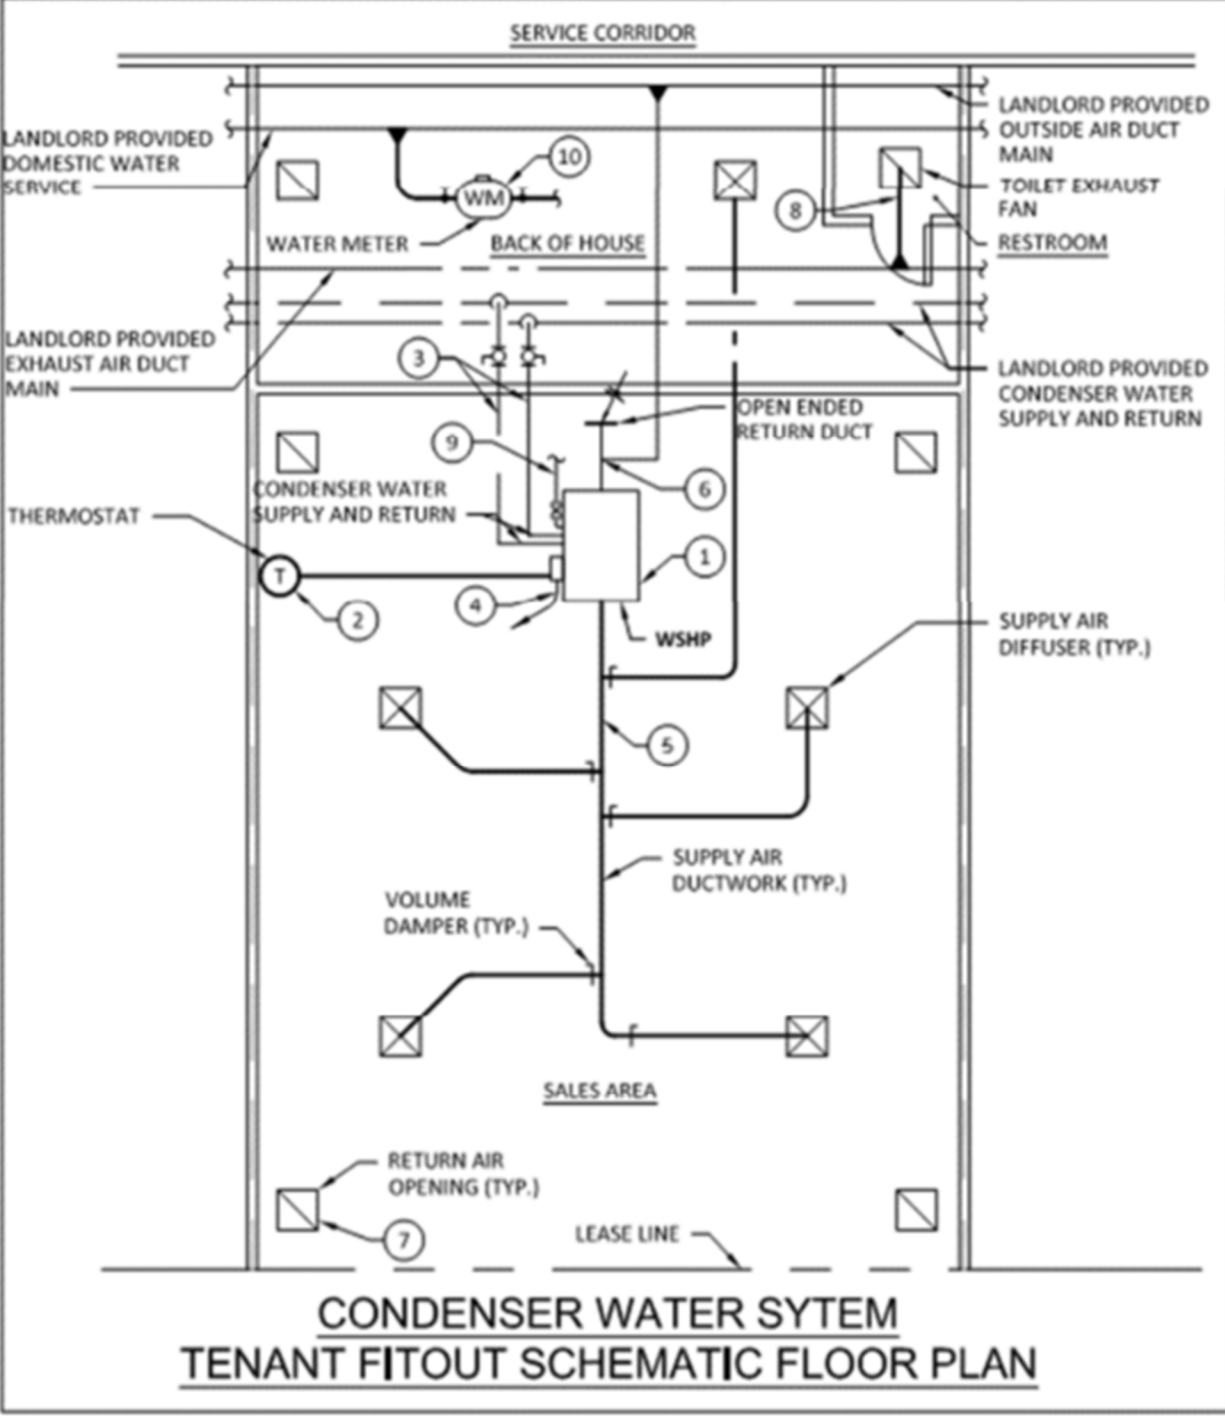



**E & S**  
CONSTRUCTION ENGINEERS, INC.  
4326 MOUNTAIN ROAD  
PASADENA, MARYLAND 21122  
(410) 360-2280

PROJECT	The Mall of Green Hills		
PROJECT NUMBER	2020022	DATE	10-20-2021
BY	RV	PAGE NUMBER	2 OF 5

DRAWING KEY NOTES:

① TENANT WATER SOURCE HEAT PUMP (WSHP)

TENANT SHALL BE RESPONSIBLE FOR FURNISHING AND INSTALLING WATER SOURCE HEAT PUMP(S) AS REQUIRED TO CONDITION LEASED PREMISES. REFER TO WATER SOURCE HEAT PUMP DETAIL FOR INFORMATION ON WSHP REQUIRED ACCESSORIES AND CONNECTIONS. ACCESS TO WSHP(S) THROUGH CEILING MUST BE PROVIDED AND MAINTAINED BY TENANT.

② UNITARY CONTROLLER & PROGRAMMABLE THERMOSTAT

THE WSHP SHALL BE PROVIDED WITH A CONTROLLER CAPABLE OF OPERATING THE EQUIPMENT INDEPENDENTLY OF THE CENTER'S BUILDING AUTOMATION SYSTEM. A PROGRAMMABLE THERMOSTAT WIRED TO THE UNITARY CONTROLLER SHALL BE WALL MOUNTED 48" ABOVE FINISHED FLOOR IN THE AREA TO BE CONTROLLED AND IN A LOCATION THAT IS NOT RESTRICTED FROM AIR CIRCULATION.

③ CONDENSER WATER PIPING

TENANT SHALL PROVIDE CONDENSER WATER PIPING FROM THE LANDLORD POINT OF CONNECTION WITHIN THE LEASED PREMISES TO EACH WSCU. PROVIDE A SINGLE HIGH POINT MANUAL AIR VENT FOR USE DURING STARTUP AND A MINIMUM OF TWO (2) LOW POINT DRAINS (ONE ON EACH SIDE OF WSCU) IN TENANT CONDENSER WATER LOOP.

④ ELECTRICAL SERVICE TO WSCU

TENANT SHALL PROVIDE A DEDICATED POWER FEED FROM TENANT PANEL TO EACH WSCU AND A SERVICE DISCONNECT SWITCH ADJACENT TO EACH WSCU UNIT FOR SERVICING OF EQUIPMENT. ACCESS TO THE DISCONNECT SWITCH SHALL BE PROVIDED AND MAINTAINED.

⑤ SUPPLY AIR SYSTEM

SUPPLY AIR DUCTWORK SHALL BE RIGID GALVANIZED SHEET METAL. ALL CONCEALED SUPPLY DUCTWORK SHALL BE EXTERNALLY INSULATED WITH A CONTINUOUS VAPOR BARRIER PER GOVERNING CODES. PROVIDE FLEXIBLE DUCT CONNECTIONS FOR ALL MECHANICAL EQUIPMENT.

⑥ OUTSIDE & RETURN AIR SYSTEM

TENANT SHALL PROVIDE AN OUTSIDE AIR FAN (IF REQUIRED) AND ASSOCIATED OUTSIDE AIR DISTRIBUTION DUCTWORK. ALL OUTSIDE AIR DUCTWORK SHALL BE RIGID GALVANIZED SHEET METAL AND EXTERNALLY INSULATED WITH A CONTINUOUS VAPOR BARRIER. THE OUTSIDE AIR DUCTWORK SHALL BE ROUTED/CONNECTED TO THE LANDLORD PROVIDED OUTSIDE AIR DUCT MAIN TAP WITHIN THE LEASED PREMISES. A MOTOR OPERATED DAMPER SHALL BE PROVIDED TO CLOSE OFF OUTSIDE AIR DUCTWORK WHEN WSCU IS NOT OPERATING. RETURN AIR DUCTWORK SHALL BE RIGID GALVANIZED SHEET METAL. PROVIDE FLEXIBLE DUCT CONNECTIONS FOR ALL MECHANICAL EQUIPMENT.

⑦ RETURN AIR DEVICES

TENANT SHALL FURNISH AND INSTALL RETURN AIR GRILLES THAT OPEN INTO THE RETURN AIR PLENUM ABOVE THE TENANT'S SPACE IN SIZE/QUANTITIES REQUIRED TO MAINTAIN A MAXIMUM 0.08 IN. W.G. STATIC PRESSURE DROP BASED OFF THE SMOKE EVACUATION SYSTEM AIRFLOW.



**E & S**  
CONSTRUCTION ENGINEERS, INC.  
4326 MOUNTAIN ROAD  
PASADENA, MARYLAND 21122  
(410) 360-2280

PROJECT	The Mall of Green Hills		
PROJECT NUMBER	2020022	DATE	10-20-2021
BY	RV	PAGE NUMBER	3 OF 5

DRAWING KEY NOTES:

⑧ TOILET EXHAUST

TENANT SHALL PROVIDE TOILET EXHAUST FAN(S) WITH BACKDRAFT DAMPER AND ASSOCIATED EXHAUST DUCTWORK. EXHAUST DUCTWORK SHALL BE RIGID GALVANIZED SHEET METAL AND ROUTED/CONNECTED TO THE LANDLORD PROVIDED EXHAUST AIR DUCT MAIN TAP

⑨ CONDENSATE CONTROL

THE TENANT SHALL PROVIDE A CONDENSATE TRAP AND CONDENSATE DRAIN PIPING FROM EACH **WSHP** ROUTED TO AN INDIRECT WASTE CONNECTION DISCHARGING TO THE SANITARY DRAINAGE SYSTEM. CONDENSATE OVERFLOW PROTECTION SHALL BE PROVIDED FOR EACH **WSHP** IN THE FORM OF AN ADDITIONAL WATERTIGHT PAN OF CORROSION-RESISTANT MATERIAL WITH A WATER LEVEL DETECTION DEVICE INSTALLED BENEATH THE COOLING COIL UNIT TO CATCH THE OVERFLOW CONDENSATE DUE TO A CLOGGED PRIMARY CONDENSATE DRAIN AND TO SHUT OFF THE EQUIPMENT.

⑩ WATER METER

TENANT SHALL PROVIDE WATER METER FOR RESTAURANT TENANTS WITH REMOTE READOUT CAPABILITIES FOR MONITORING BY LANDLORD BAS (TRICON S REGISTER OR EQUIVALENT).



**E & S**  
CONSTRUCTION ENGINEERS, INC.  
4326 MOUNTAIN ROAD  
PASADENA, MARYLAND 21122  
(410) 360-2280

PROJECT

The Mall of Green Hills

PROJECT  
NUMBER

2020022

DATE


10-20-2021

BY

RV

PAGE  
NUMBER

4 OF 5

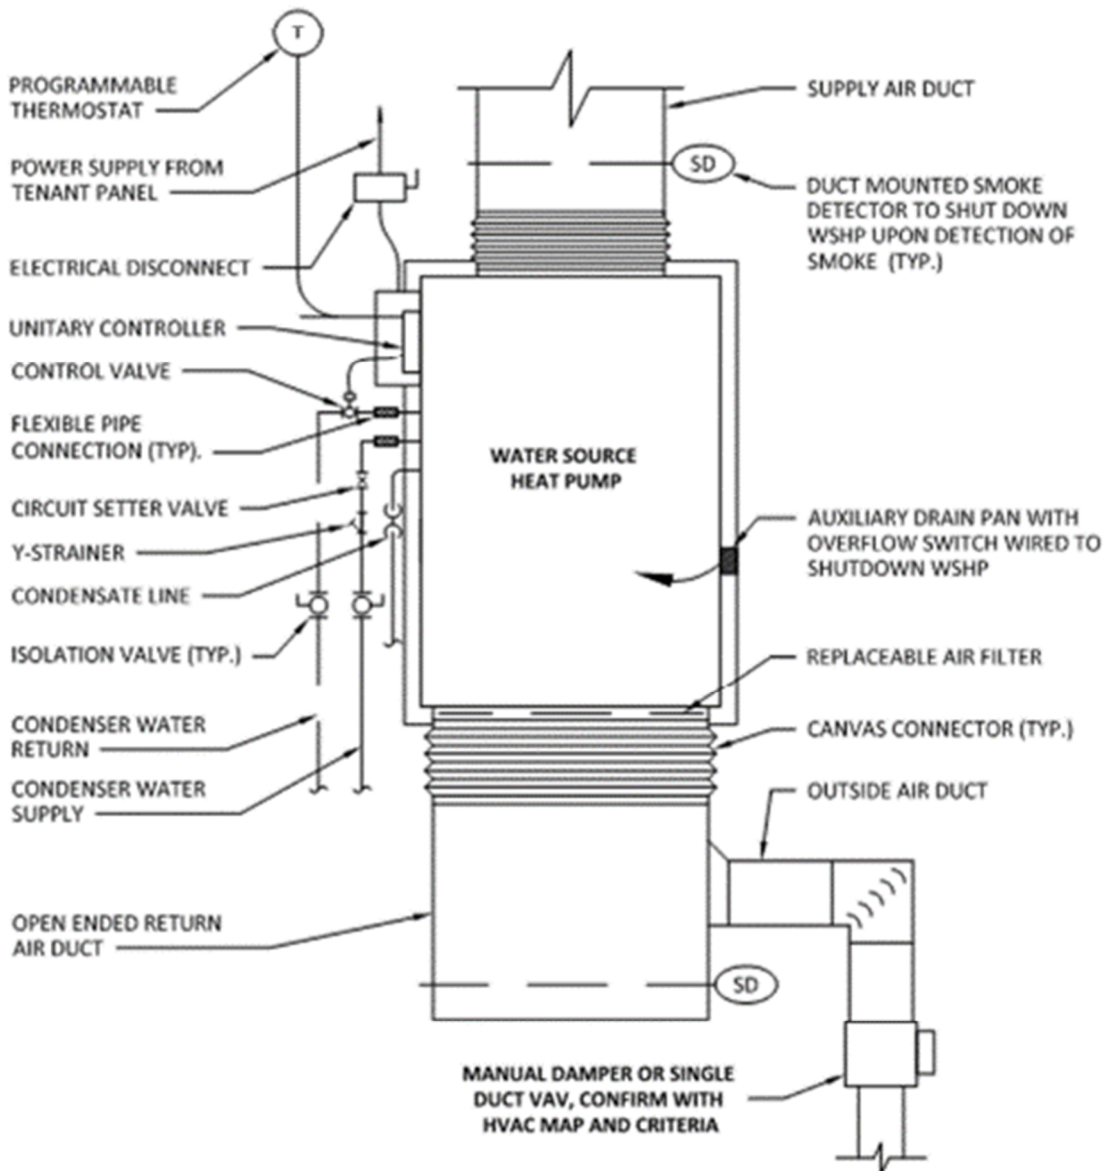

## TENANT WATER SOURCE HEAT PUMP DETAIL



**E & S**  
CONSTRUCTION ENGINEERS, INC.  
4326 MOUNTAIN ROAD  
PASADENA, MARYLAND 21122  
(410) 360-2280

PROJECT

The Mall of Green Hills

PROJECT  
NUMBER

2020022

DATE



10-20-2021

BY

RV

PAGE  
NUMBER

5 OF 5

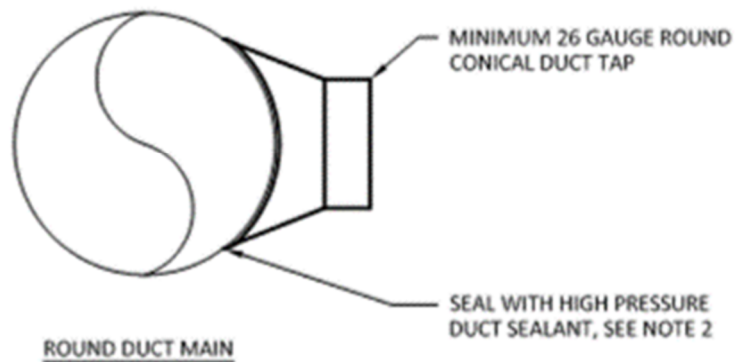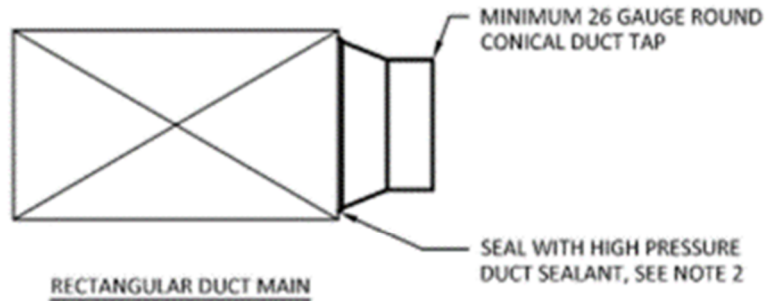



NOTES:

1. TENANTS REQUIRING ADDITIONAL OUTSIDE OR EXHAUST AIR TAPS SHALL COORDINATE WITH LANDLORD FOR APPROVAL. MODIFICATIONS TO BASE BUILDING SYSTEMS SHALL BE INSPECTED BY THE LANDLORD PRIOR TO THE COVERING OF ANY WORK.
2. DUCT SEALANT SHALL BE UL 181 LISTED AND SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX NOT TO EXCEED 25 AND A SMOKE-DEVELOPED INDEX NOT TO EXCEED 50.

TENANT DUCTWORK MAIN CONNECTION DETAIL



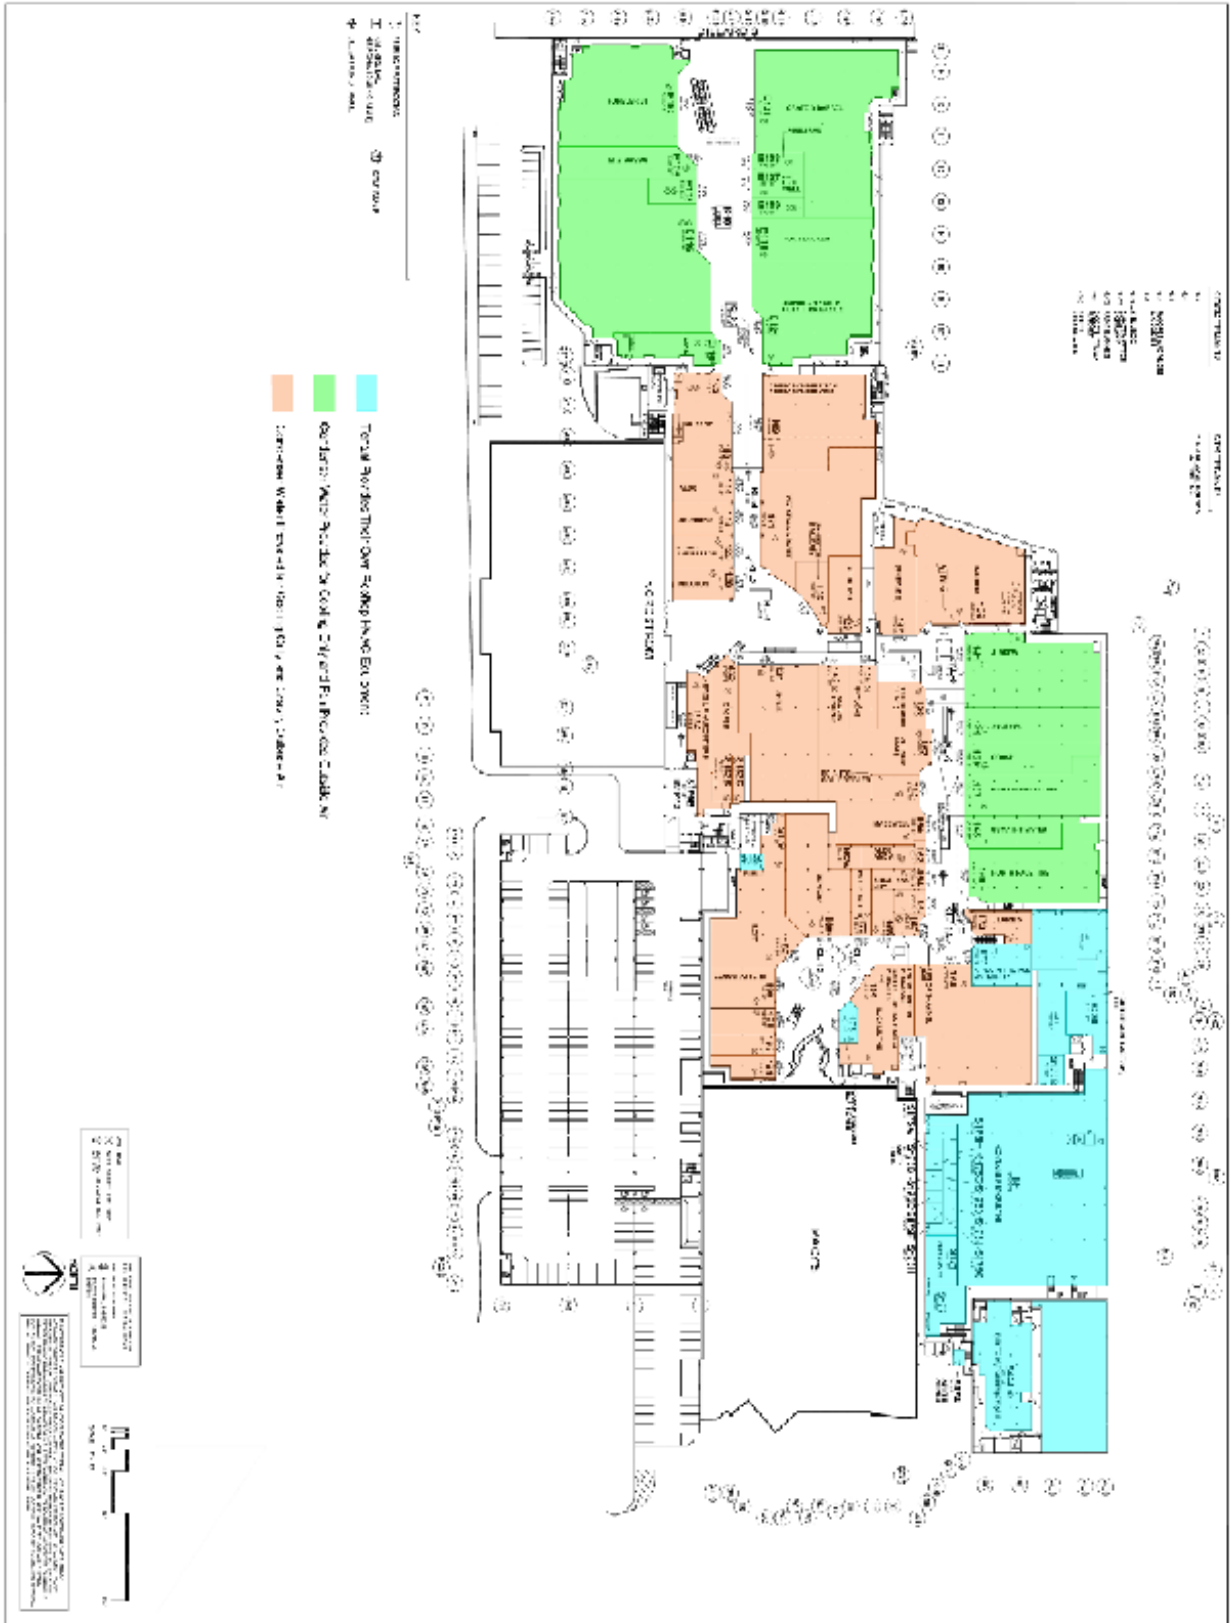

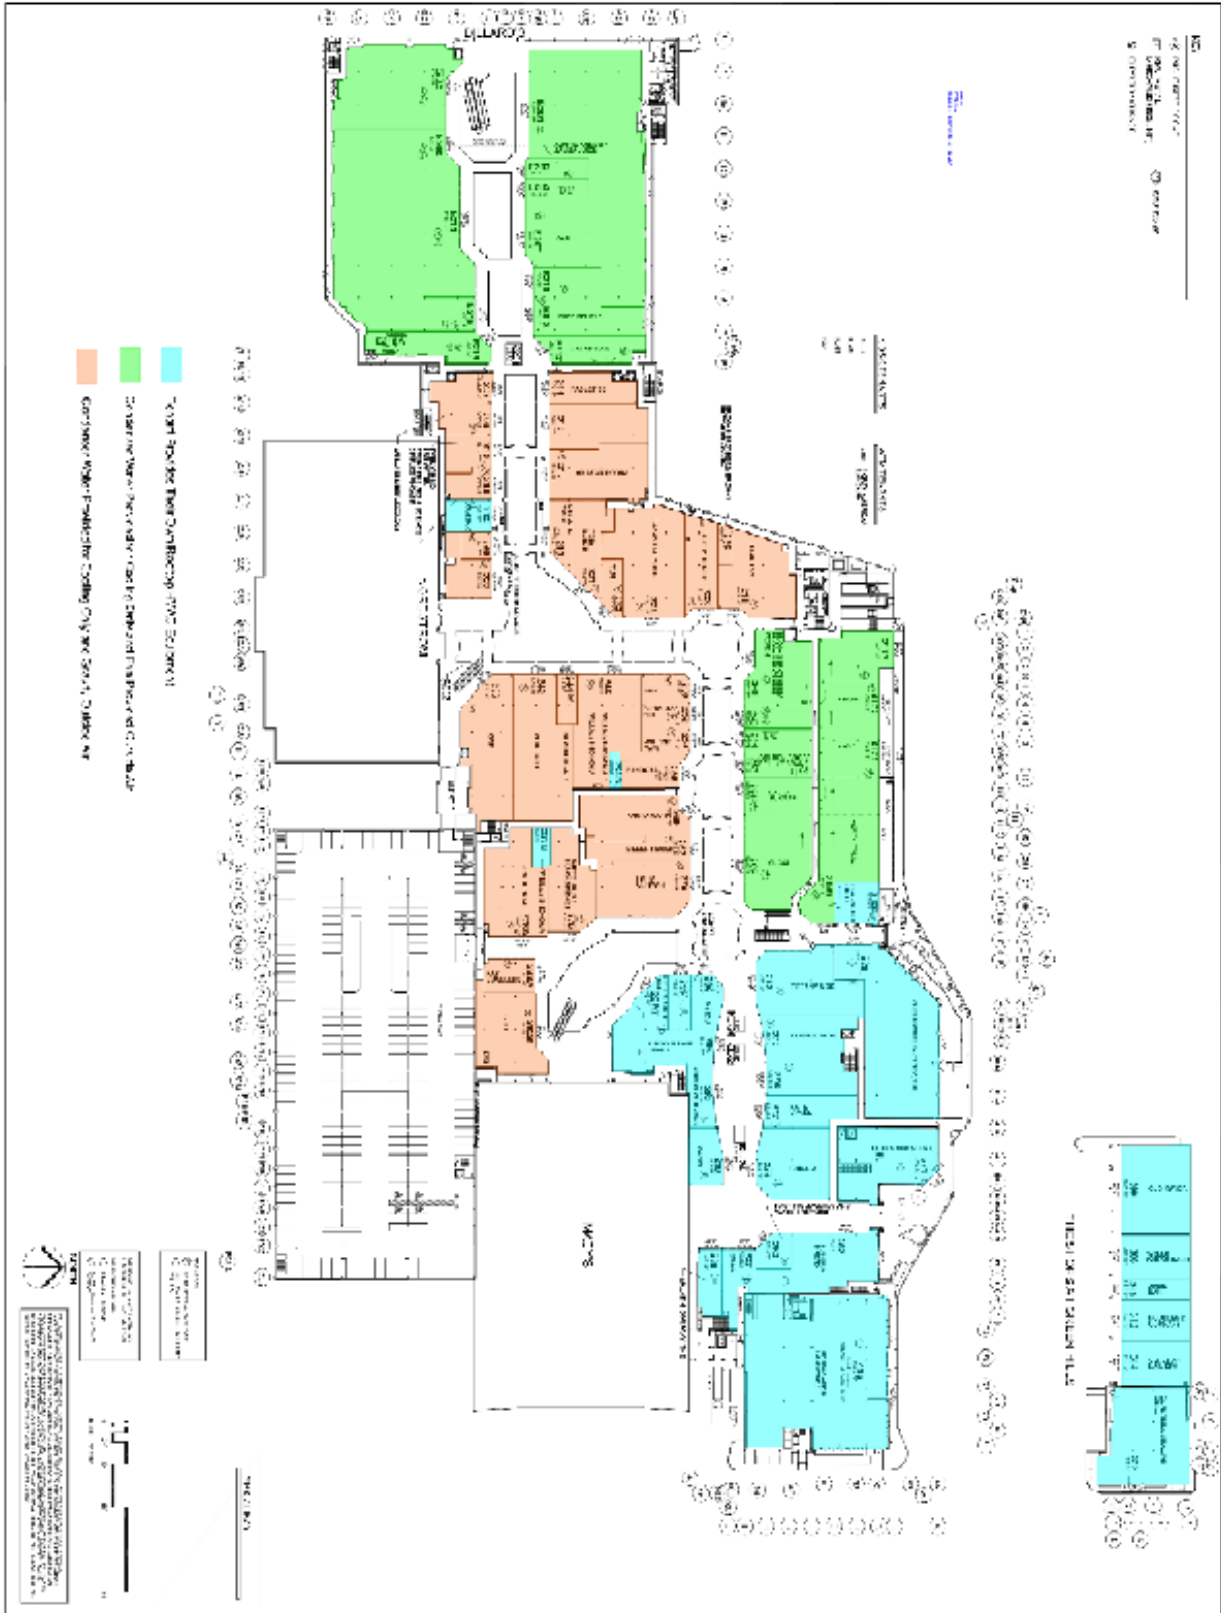

2017.2

**THE MALL AT GREEN HILLS**  
LEASING PLAN - UPPER LEVEL

RECREATIONAL DEVELOPMENT  
8001 2117, TN

**Taubman**

1801 BURNING WOOD  
SUITE 500 FLEMING, TN 37069

615.252.0000  
615.252.0001  
615.252.0002  
615.252.0003  
615.252.0004  
615.252.0005  
615.252.0006  
615.252.0007  
615.252.0008  
615.252.0009  
615.252.0010